


**Figure 1: Counties with potentially increased miscarriage and birth defect risks from chlorination byproducts, based on measured THM levels in tap water from community water suppliers**

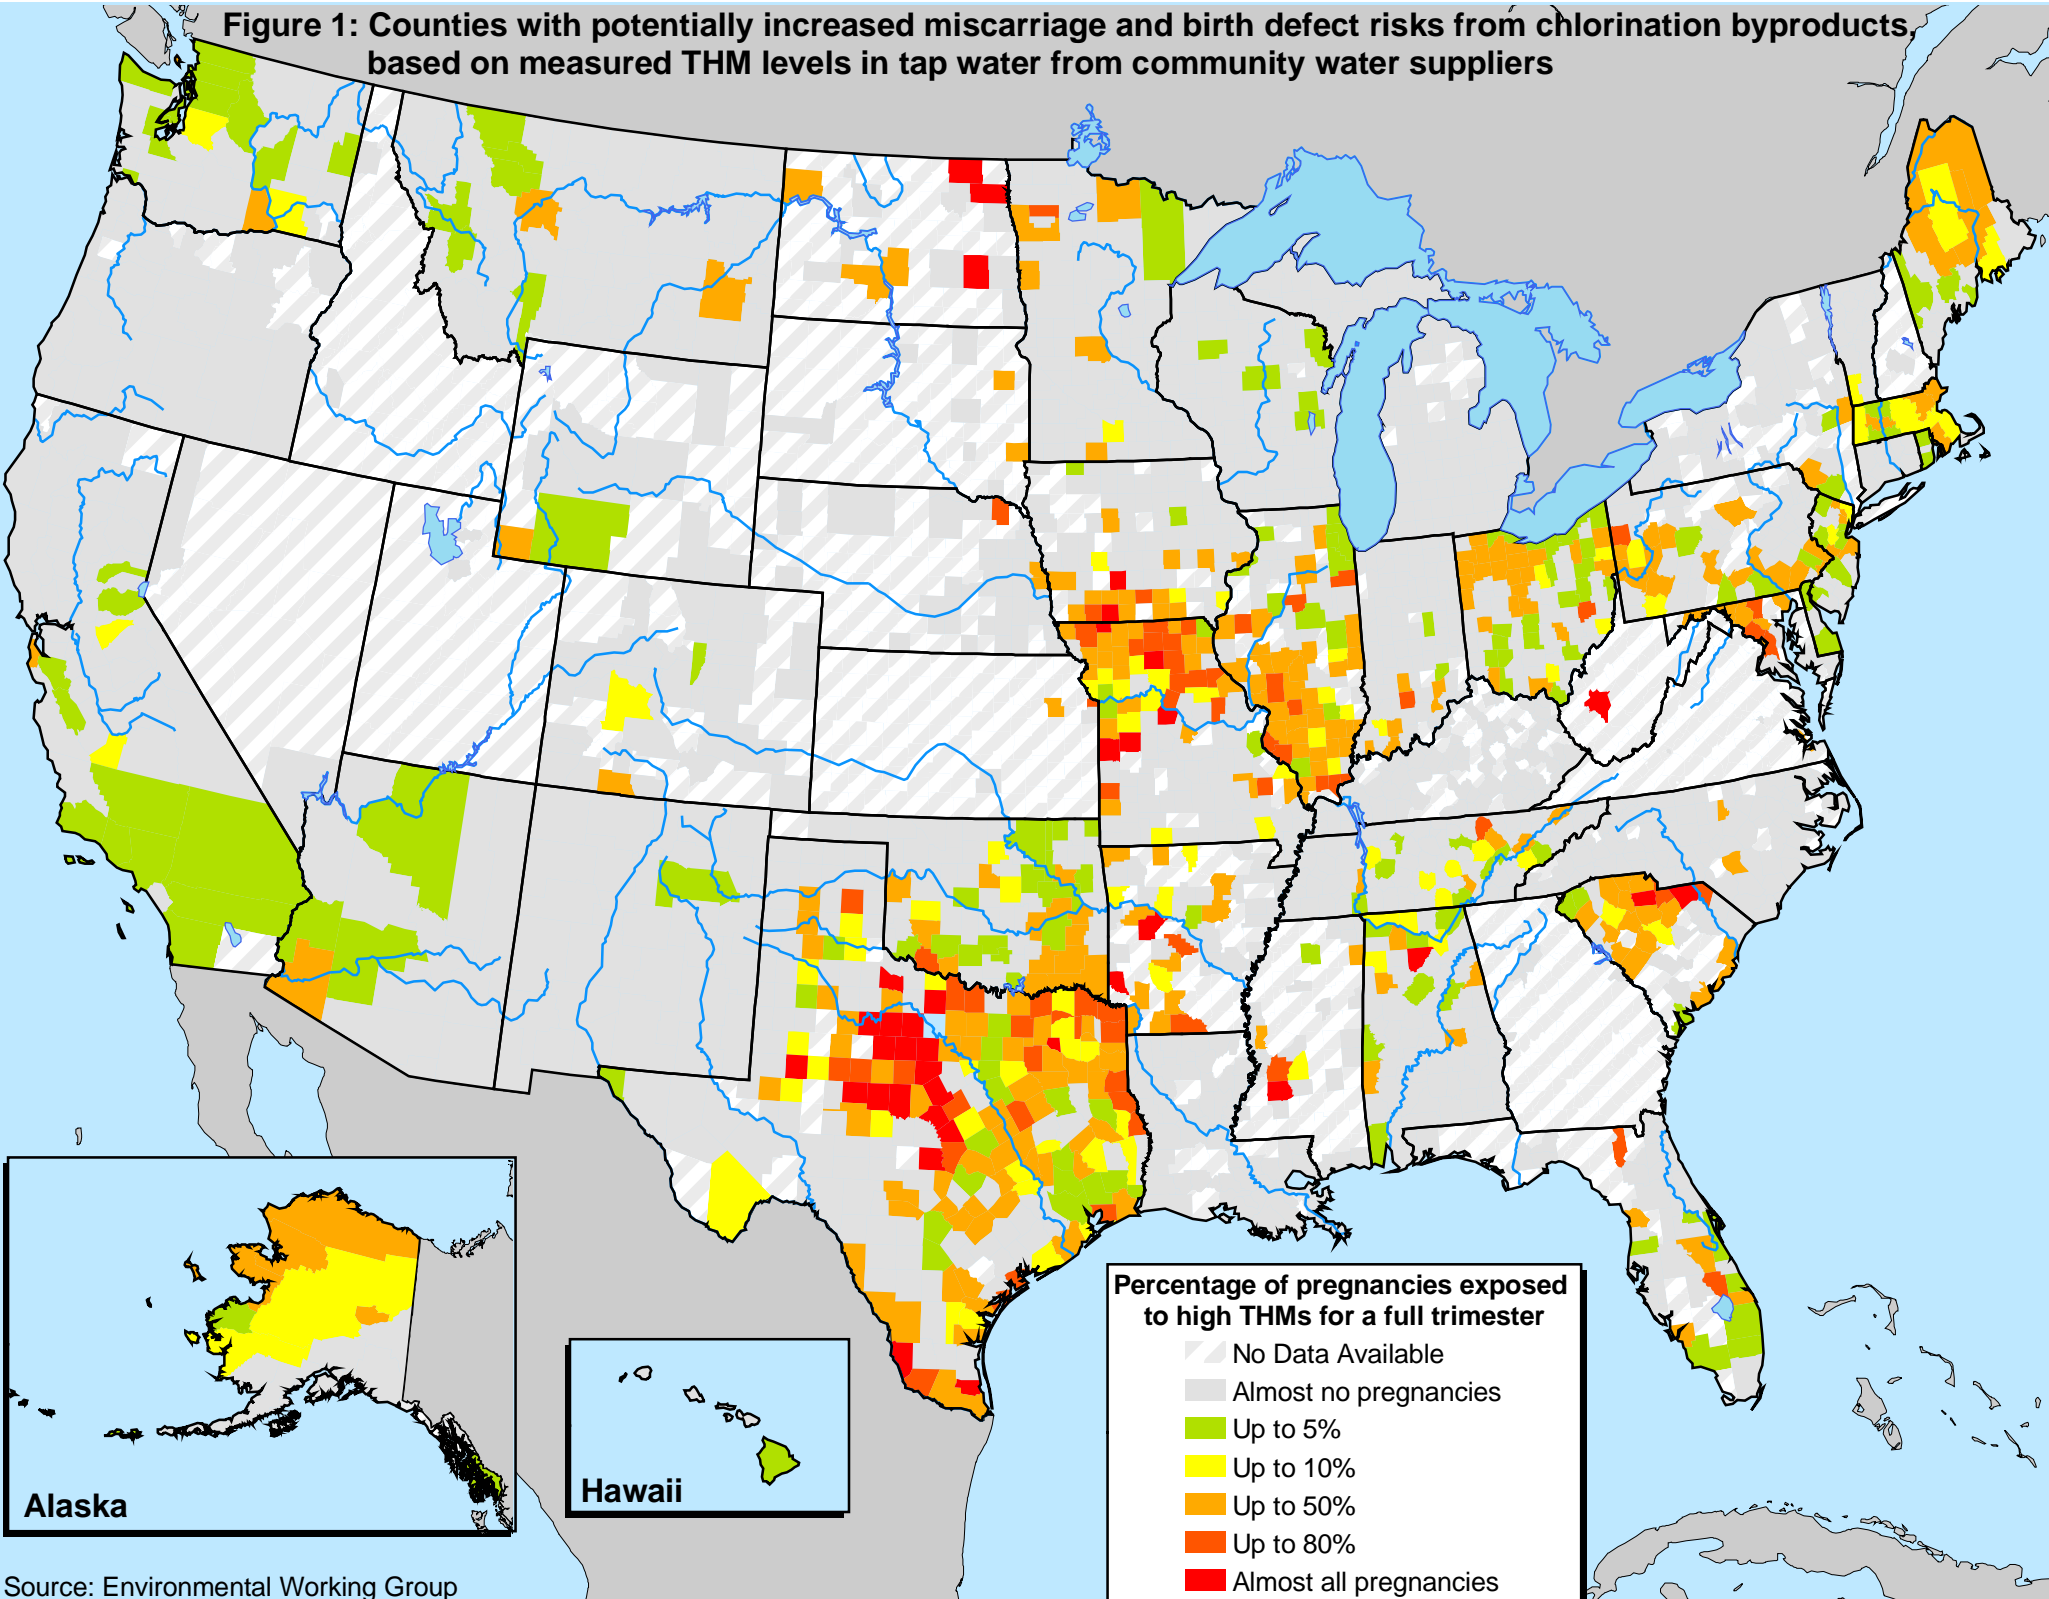

Source: Environmental Working Group